

ボイラー管理記録


11月

月	日	給水		重油		蒸発倍数	稼働時間			
		メーター読み	使用量	メーター読み	使用量		開始	終了		
酸素注入運転	1	火	8,446,735	12,915	606,097.2	1,226.5	10.5	7:30	7:35	
	2	水	8,458,166	11,431	607,127.3	1,030.1	11.1	7:30	7:35	
	3	木	8,471,746	13,580	608,381.1	1,253.8	10.8	7:30	7:35	
	4	金	8,483,413	11,667	609,452.4	1,071.3	10.9	7:30	7:35	
	7	月	8,493,844	10,431	610,431.5	979.1	10.7	7:15	7:20	
	8	火	8,506,347	12,503	611,634.6	1,203.1	10.4	7:15	7:20	
	酸素注入運転 ダンパー絞る	9	水	8,522,533	16,186	612,948.2	1,313.6	12.3	7:15	7:20
		10	木	8,537,017	14,484	614,173.5	1,225.3	11.8	7:20	7:25
11		金	8,554,505	17,488	615,559.0	1,385.5	12.6	7:20	7:25	
14		月	8,568,920	14,415	616,754.0	1,195.0	12.1	7:10	7:15	
15		火	8,585,058	16,138	618,118.6	1,364.6	11.8	7:10	7:15	
16		水	8,603,989	18,931	619,712.8	1,594.2	11.9	7:10	7:15	
17		木	8,619,910	15,921	620,979.8	1,267.0	12.6			
18		金	8,635,632	15,722	622,300.2	1,320.4	11.9			
合計				201,812		17,430				

ボイラー管理記録

10月

月	日	給水		重油		蒸発倍数	稼働時間		
		メーター読み	使用量	メーター読み	使用量		開始	終了	
ノーマル運転	3	月	8,196,678		583,933.0			7:45	19:50
	4	火	8,210,223	13,545	585,133.1	1,200	11.3	7:30	19:35
	5	水	8,221,778	11,555	586,174.6	1,041.5	11.1	7:30	19:35
	6	木	8,233,714	11,936	587,226.2	1,051.6	11.4	7:30	19:35
	7	金	8,247,199	13,485	588,415.7	1,189.5	11.3	7:30	19:35
	11	火	8,274,635	27,436	590,830.7	2,415.0	11.4	7:30	19:35
	酸素注入運転	12	水	8,284,392	9,757	591,611.2	780.5	12.5	7:30
13		木	8,295,102	10,710	592,469.6	858.4	12.5	7:30	19:35
14		金	8,306,905	11,803	593,429.8	960.2	12.3	7:25	19:30
17		月	8,317,505	10,600	594,304.3	874.5	12.1	7:00	19:05
18		火	8,331,532	14,027	595,526.7	1,222.4	11.5	7:10	19:15
19		水	8,343,349	11,817	596,593.7	1,067.0	11.1	7:15	19:20
20		木	8,358,171	14,822	597,943.5	1,349.8	11.0	7:20	19:25
21		金	8,362,399	4,228	598,306.5	363.0	11.6	7:20	19:25
24		月	8,371,688	9,289	599,179.4	872.9	10.6	7:20	19:25
25		火	8,382,890	11,202	600,231.5	1,052.1	10.6	7:30	19:35
26		水	8,395,941	13,051	601,406.6	1,175.1	11.1	7:30	19:35
27		木	8,408,937	12,996	602,595.3	1,189	10.9	7:45	19:50
28		金	8,421,517	12,580	603,759.2	1,164	10.8	7:30	19:35
31		月	8,433,820	12,303	604,870.7	1,111.5	11.1	7:30	19:35
合計				100,434,654	138,718	7,188,147	12,401		

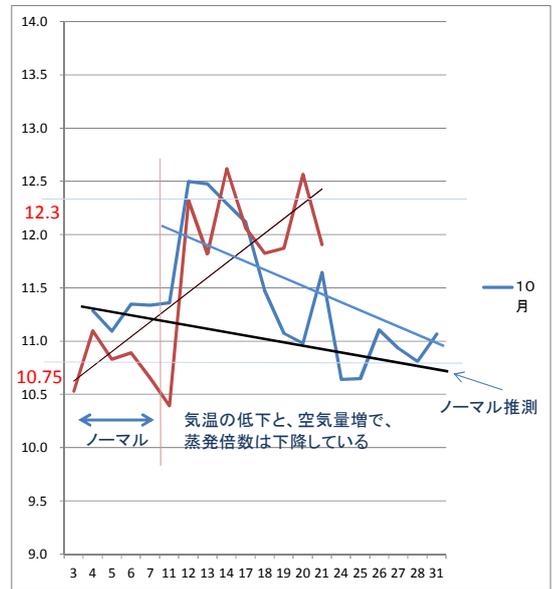

ノーマル推測	10.75	酸素運転推測	12.3
蒸発倍数	向上		14.4%